




PO Box 6256
 Mobile AL, 36606
 1-800-771-6643

APPLICATION DETAILS

TPO Metal Recover Fully Adhered Systems

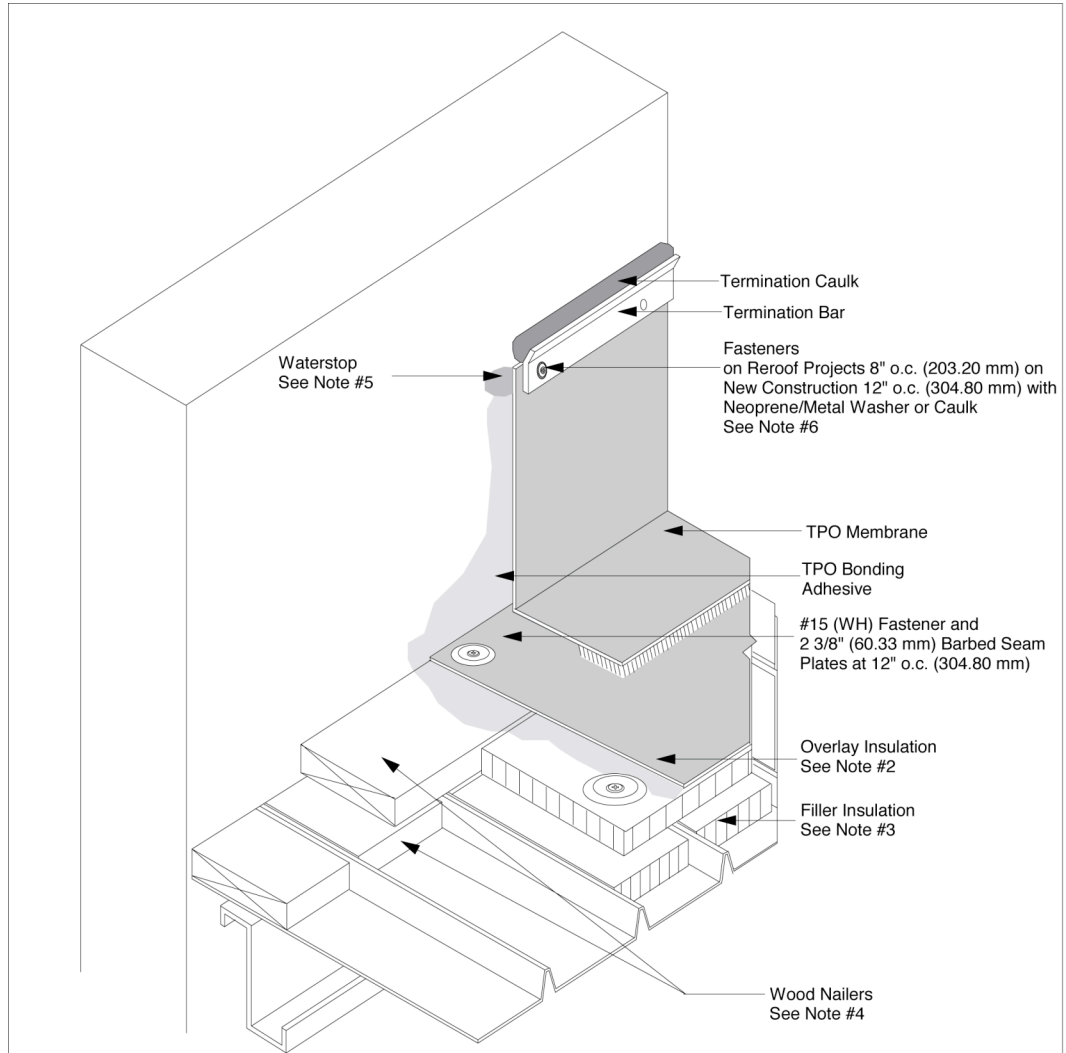

1. Secure acceptable vertical substrate material to metal siding, and ensure structural attachment (purlin) along at least two lines of securement.
2. Overlay insulation must comply with minimum requirements called for to span openings in filler insulation and to comply with AWS Fully Adhered System requirements. Secure at the rate of one #15 (WH) Fastener and Insulation Plate per 2 ft² (0.19 m²), i.e. 16 per 4' x 8' (1.22 m x 2.44 m).
3. Filler insulation should be sized to fit snugly between ribs and of equal thickness to rib height.
4. Wood nailers must be secured to purlins as required to achieve 200 lb (889.64 N) of pullout resistance per linear foot.
5. Compression fit details that incorporate Waterstop must have all existing flashing removed to the bare substrate, e.g. masonry block.
6. Any approved pre-drilled fastener for curb and parapet terminations must have a minimum 125 lb (556.03 N) pullout. See approved fastener list.



Metal Roof Base Flashing

TPO Metal Roof Recover Systems